

DC1-80 SERIES OPERATING INSTRUCTIONS

INPUT RATINGS: 9-18VDC, 15A

OUTPUT RATINGS: 80 Watts Max. Output Power with 300 LFM Forced Air. Open Frame or with Chassis/Cover.
 60 Watts Max. Output Power Convection Cooled. Open Frame or with Chassis. Single Outputs.
 50 Watts Max. Output Power Convection Cooled. Open Frame or with Chassis. Multi Outputs.
 50 Watts Max. Output Power Convection Cooled with Chassis/Cover. Single Outputs.
 40 Watts Max. Output Power Convection Cooled with Chassis/Cover. Multi Outputs.

MODEL LISTING:	MODEL	OUTPUT 1	OUTPUT 2	OUTPUT 3	OUTPUT 4
	DC1-80-4001	+3.3V/6A	+5V/5A	+12V/2A	-12V/2A
	DC1-80-4002	+5V/6A	+3.3V/5A	+12V/2A	-12V/2A
	DC1-80-4003	+5V/6A	-5V/5A	+12V/2A	-12V/2A
	DC1-80-4004	+5V/6A	-5V/5A	+15V/2A	-15V/2A
	DC1-80-4005	+5V/6A	+24V/2A	+12V/2A	-12V/2A
	DC1-80-4006	+5V/6A	+24V/2A	+15V/2A	-15V/2A
	DC1-80-3001	+5V/6A	+12V/2A		-12V/2A
	DC1-80-3002	+5V/6A	+15V/2A		-15V/2A
	DC1-80-2001	+5V/6A	+12V/4A		
	DC1-80-2002	+5V/6A	+24V/2A		
	DC1-80-2003	+12V/3.5A	-12V/3.5A		
	DC1-80-2004	+15V/3A	-15V/3A		
	DC1-80-1001	5V/16A			
	DC1-80-1002	12V/6.7A			
	DC1-80-1003	15V/5.3A			
	DC1-80-1004	24V/3.3A			
	DC1-80-1005	28V/2.9A			
	DC1-80-1006	36V/2.2A			
	DC1-80-1007	48V/1.5A			

NOTES: 1. A suffix may be added to the model number to indicate the following optional configurations:
 (CH-chassis, CO-cover, IO-isolated outputs, TS-terminal strip).

CLASSIFICATION:

1. Protection against electric shock – Class I.
2. Protection against harmful ingress of water – IPX0 (Non-protected), ordinary.
3. Methods of sterilization – None.
4. Suitability for use in an oxygen rich environment – End user responsibility, not evaluated.
5. Mode of operation – Continuous.

ENVIRONMENTAL: For Indoor Use Only.
 No protective packaging required during transport.
 Operating Temperature- 0-50°C
 Storage Temperature- -40-85°C
 Operating / Storage Humidity- 0-95%RH non-condensing
 Operating Altitude- 3000m max.



DECLARATION OF CONFORMITY

Manufacturer: Integrated Power Designs, Inc.
 Manufacturer's Address: 300 Stewart Road, Wilkes-Barre, PA 18706 USA

Declares all models listed above including all options are in compliance with the following European Community Directives:

RoHS Directive 2011/65/EU of 8 June 2011

In addition, all models are Certified to be in compliance with applicable requirements of UL 62368-1:2014, ANSI/AAMI ES60601:2005/(R) 2012 IEC 62368-1:2014 and IEC 60601-1:2005/A1:2012 including all EU national deviations, CAN/CSA C22.2 NO. 62368-1-14, CAN/CSA- C22.2 No. 60601-1:2014, EN EN 62368-1:2014 and EN 60601-1:2006/A1:2013.

BY: Steven Thompson- President



PLACE: Integrated Power Designs
 300 Stewart Road, Wilkes-Barre, PA 18706 USA

DATE: February 20, 2018

EUROPEAN CONTACT:
 CompuMess Elektronik GmbH
 Lise-Meitner-Strasse 1
 85716 Unterschleißheim
 Telephone: (089) 32 15 01-0

DC1-80 SERIES OPERATING INSTRUCTIONS

**WARNING!
SHOCK HAZARD:**

Dangerous voltages are present on some components, printed circuit board traces and heatsinks.

**WARNING!
RISK OF FIRE:**

An open internal fuse indicates a catastrophic failure of circuit component(s). Repair must be by authorized IPD personnel only.
Refer to fuse rating on power supply circuit board for rating.

**WARNING!
SEPERATION:**

Modification of this equipment is prohibited without the authorization of the manufacturer.

OUTPUTS:

The outputs are not acceptable for patient connection without additional isolation. All outputs are SELV under normal and single fault conditions unless otherwise indicated.

TEMPERATURES:

The maximum operating temperatures of safety components as defined in the applicable safety standards must not be exceeded after installation in the end use equipment. Output power, ambient air temperature and convection or forced air cooling availability should be considered in the end use equipment.


HIPOT:

In consideration of IEC 60601:2005 Clause 8.8.3, care must be taken to insure the voltage applied to a reinforced insulation does not overstress different types and levels of insulation. Breakdown of basic insulation and catastrophic failure of the power supply may result if a test voltage of greater than 1500 VAC is applied between primary and secondary circuits. Each isolating component is factory tested at 3000 VAC minimum prior to installation. Primary and secondary to ground capacitors may need to be disconnected prior to performing a dielectric strength test on the power supply or the end product.

INSTALLATION:

The power supplies included in model listing on reverse side are considered components intended for professional installation into end use equipment. The protective earth (ground) terminal must be bonded to protective earth in the end use equipment.

**CONNECTIONS /
DIMENSIONS:**

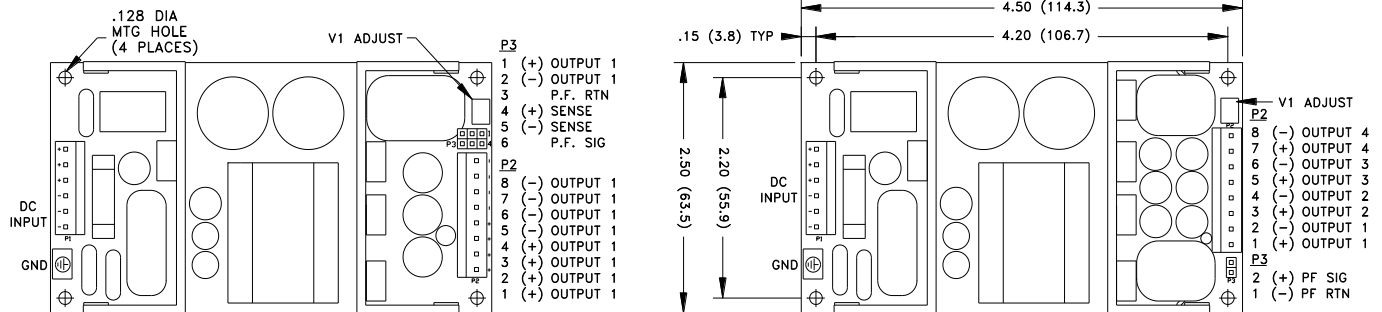

CONNECTORS:

P1: DC Input - .156 friction lock header mates with Tyco 770849-6 or equiv. crimp terminal housing with Tyco 3-640707-1 or equivalent crimp terminal

P2: DC Output (Single and Multiple) - .156 friction lock header mates with Tyco 770849-8 or equivalent crimp terminal housing with Tyco 3-640707-1 or equivalent crimp terminal.

G: Ground- .187 quick disconnect terminal.

P3: P.G./Sense (Single) - .100 breakaway header mates with Molex 22-55-2061 or equivalent crimp terminal housing with Molex type 71851 or equivalent crimp terminal.

P3: Power Good (Multi) - .100 breakaway header mates with Molex 50-57-9002 or equiv. crimp terminal housing with Molex type 71851 or equiv. crimp terminal.